

# Modbus TCP

L2003592-C 15.04.2024

---

## 01 Introduction

The Modbus interface on DUCO systems (via the Duco Connectivity Board option on a DucoBox)<sup>1</sup> allows an external controller or building management system to communicate with the DUCO ventilation system.

In this way, one can request info about the ventilation network, or via write parameters or holding registers read or adjust settings.

The supported protocol is Modbus TCP over Ethernet or Wi-Fi via the Duco Connectivity Board.

---

<sup>1</sup> Duco Connectivity Board option only possible on DucoBox Silent Connect, DucoBox Focus and DucoBox Energy (all variants).

## 02 Working with registers / parameters

The DucoBox Silent Connect, Focus and Energy support the following Modbus subset:


HEX	DEC	SUPPORT FUNCTION
0x03	3	Read multiple HOLDING registers
0x04	4	Read multiple INPUT registers
0x06	6	Write single HOLDING register
0x10	16	Write multiple HOLDING registers

Here, input registers are 16-bit read-only variables and holding registers are 16-bit read/write variables. The Duco Connectivity Board functions as a Modbus slave via TCP along port 502. The Modbus address can be set via the Display menu (see information sheet L8000002), the Duco Installation App or the Duco Network Tool.

The external control unit communicates with each component (node) through read parameters (INPUT) and write parameters (HOLDING).

- Read parameters (INPUT): ventilation system type, ventilation status, indoor air quality based on relative humidity, indoor air quality based on CO<sub>2</sub> value, ...
- Write parameters (HOLDING): ventilation status, identification (of components), ...

Each node and its parameters are assigned a code: **XXyy** (**XX**=node number, **yy**=parameter number).

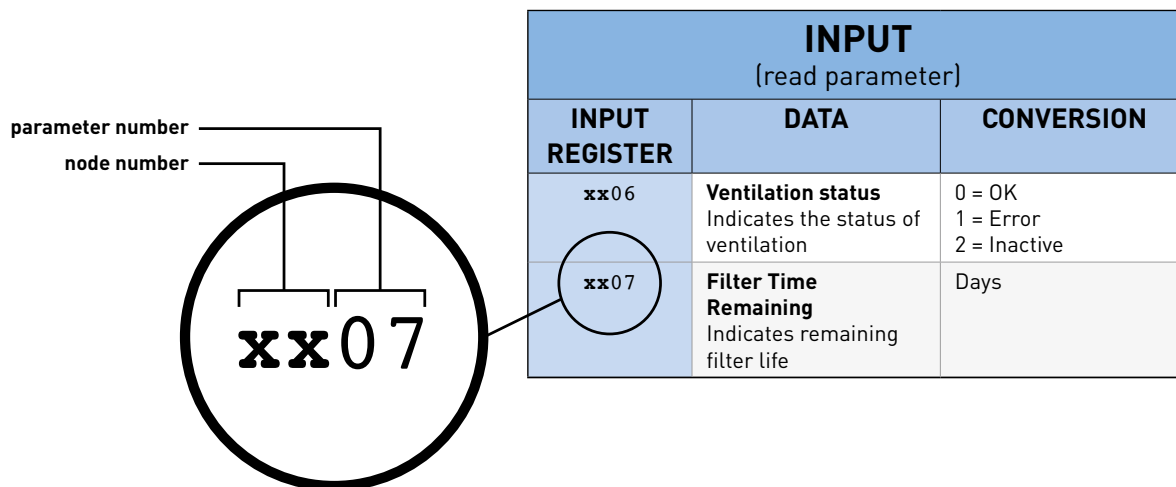

This allows all values to be read and controlled from the external control unit. There are specific parameters for each component.



Due to a difference in some Modbus implementations compared to the official specification (on which our implementation is based), an address shift of '1' may occur for the read and write parameters.

E.g.: read address '20' will become '19'.

For any box type (Silent Connect, Focus, Energy), this can be resolved via the Duco Installation App or the Duco Network Tool under tab >Tree view-Settings-external settings. With the DucoBox Focus, moreover, this can be solved by setting '>RegOffs' to '1' under >CONFIG>Modbus in the Display menu. With the DucoBox Energy also via "Register Offset" under >Settings>Modbus in the advanced menu.

# 03 Overview of parameters

The overview is grouped into two sections:

- Parameters supported only by the DucoBox
- Parameters supported by the components

Below you will find an overview of the INPUT and HOLDING parameters for both the ventilation system and the components.

## DucoBox parameters:

INPUT (read parameter)				
Input register	Data	Conversion		Application
0100	<b>System type</b> Indicates the type of ventilation system	17 = DucoBox		DucoBox Silent Connect DucoBox Focus DucoBox Energy
0102	<b>Remaining time Current Ventilation mode</b> Indicates the remaining time the DucoBox will ventilate in this mode	Seconds		DucoBox Silent Connect DucoBox Focus DucoBox Energy
0103	<b>Flow rate versus target level</b> Displays the actual ventilation setting for the zone in which the component is located	Percentage		DucoBox Silent Connect DucoBox Focus DucoBox Energy
0104	<b>Indoor air quality based on RH</b> Average indoor air quality based on measured relative humidity	100% 95%	Very good indoor air quality	Box sensor DucoBox Silent Connect Box sensor DucoBox Energy
		90% 80% 65%	Good indoor air quality	
		50% 35%	Temporarily acceptable indoor air quality	
		20% 5%	Poor indoor air quality	
0105	<b>Indoor air quality based on CO<sub>2</sub></b> Average indoor air quality based on measured CO <sub>2</sub> value	100% 95%	Very good indoor air quality	Box sensor DucoBox Silent Connect Box sensor DucoBox Energy
		90% 80% 65%	Good indoor air quality	
		50% 35%	Temporarily acceptable indoor air quality	
		20% 5%	Poor indoor air quality	

INPUT (read parameter)			
Input register	Data	Conversion	Application
0106	<b>Ventilation status</b> Indicates the status of ventilation	0 = OK 1 = Error 2 = Inactive	DucoBox Silent Connect DucoBox Focus DucoBox Energy
0107	<b>Filter Time Remaining</b> Indicates remaining filter life	Days	DucoBox Energy
0108	<b>Filter status</b> Indicates the status of the filter	0 = OK 1 = Filter is dirty 2 = Inactive	DucoBox Energy

HOLDING (write parameter)			
Input register	Data	Conversion	Application
0100	<b>Ventilation position</b> Here, the ventilation setting can be adjusted	0 = AUTO 4 = Manual 1 5 = Manual 2 6 = Manual 3 7 = Not at home 8 = Permanent 1 9 = Permanent 2 10 = Permanent 3 11 = No position possible for this component	DucoBox Silent Connect DucoBox Focus DucoBox Energy
xx02	<b>Identification</b> Here, a component can be identified. This will light up blue.	0 = Node Visualisation OFF 1 = Node Visualisation ON	DucoBox Silent Connect DucoBox Focus DucoBox Energy
0103	<b>Supply temperature target zone 1</b> Here, the comfort temperature of the SUP zone 1 can be adjusted	°C / 10	DucoBox Energy
0104	<b>Supply temperature target zone 2</b> Here, the comfort temperature of the SUP zone 2 can be adjusted	°C / 10	DucoBox Energy

**Node parameters:**

<b>INPUT</b> (read parameter)																			
Input register	Data	Conversion	Application																
xx00	<b>System type</b> Indicates the type of ventilation system	0 = Unknown 8 = Remote control RF/BAT 9 = Remote control RF/Wired 10 = Humidity Room sensor 12 =CO <sub>2</sub> Room sensor 13 = Sensorless control valve 14 = Humidity control valve 16 =CO <sub>2</sub> control valve 18 = Switch sensor 27 = Control unit 28 =CO <sub>2</sub> /RH control valve 29 = Remote control Sun Control RF/Wired 30 = Remote control Nightvent RF/Wired 31 = External multi-zone valve 35 = Humidity box sensor 37 =CO <sub>2</sub> box sensors 39 = Duco weather station	Remote control Room sensor Box sensor Control valve Switch sensor Electronic window ventilator																
xx02	<b>Remaining time Current Ventilation mode</b> Indicates the remaining time the DucoBox will ventilate in this mode	Seconds	Remote control Room sensor Control valve Switch sensor																
xx03	<b>Flow rate versus target level</b> Displays the actual ventilation setting for the zone in which the component is located	%	Control valve Electronic window ventilator																
xx04	<b>Indoor air quality based on RH</b> Average indoor air quality based on measured relative humidity	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="background-color: #90EE90; text-align: center;">100%</td> <td style="background-color: #90EE90;">Very good indoor air quality</td> </tr> <tr> <td style="background-color: #90EE90; text-align: center;">95%</td> <td style="background-color: #90EE90;"></td> </tr> <tr> <td style="background-color: #90EE90; text-align: center;">90%</td> <td style="background-color: #90EE90;"></td> </tr> <tr> <td style="background-color: #90EE90; text-align: center;">80%</td> <td style="background-color: #90EE90;">Good indoor air quality</td> </tr> <tr> <td style="background-color: #90EE90; text-align: center;">65%</td> <td style="background-color: #90EE90;"></td> </tr> <tr> <td style="background-color: #FFDAB9; text-align: center;">50%</td> <td style="background-color: #FFDAB9;">Temporarily acceptable indoor air quality</td> </tr> <tr> <td style="background-color: #FFDAB9; text-align: center;">35%</td> <td style="background-color: #FFDAB9;"></td> </tr> <tr> <td style="background-color: #FFA07A; text-align: center;">20%</td> <td style="background-color: #FFA07A;">Poor indoor air quality</td> </tr> </table>	100%	Very good indoor air quality	95%		90%		80%	Good indoor air quality	65%		50%	Temporarily acceptable indoor air quality	35%		20%	Poor indoor air quality	Room sensor Control valve
100%	Very good indoor air quality																		
95%																			
90%																			
80%	Good indoor air quality																		
65%																			
50%	Temporarily acceptable indoor air quality																		
35%																			
20%	Poor indoor air quality																		

INPUT (read parameter)			
Input register	Data	Conversion	Application
xx05	<b>Indoor air quality based on CO<sub>2</sub></b> Average indoor air quality based on measured CO <sub>2</sub> value	100% 95% 90%	Very good indoor air quality
		85% 80% 75%	Good indoor air quality
		70% 65% 60% 55% 50%	Temporarily acceptable indoor air quality
		45% 40% 35% 30%	Poor indoor air quality
			Room sensor Control valve

HOLDING (write parameter)			
Input register	Data	Conversion	Application
xx00	<b>Ventilation position</b> Here, the ventilation setting can be adjusted	0 = AUTO 4 = Manual 1 5 = Manual 2 6 = Manual 3 7 = Not at home 8 = Permanent 1 9 = Permanent 2 10 = Permanent 3 11 = Unknown	Remote control Room sensor Box sensor Control valve Electronic window ventilator
xx01	<b>Identification</b> Here, a component can be identified. This will light up blue.	0 = Node Visualisation OFF 1 = Node Visualisation ON	Remote control Room sensor Control valve Switch sensor Electronic window ventilator


# 04 General data

To find out which nodes are present in the network, one can (optionally) use the INPUT registers below. Alternatively, one can scan all registers.

Example:

INPUT REGISTER	DATA
0000	Bit field indicating which node numbers between 1 and 15 are occupied in the network
0001	Bit field indicating which node numbers between 16 and 31 are occupied in the network
0002	Bit field indicating which node numbers between 16 and 31 are occupied in the network
0003	Bit field indicating which node numbers between 48 and 63 are occupied in the network
0004	Bit field indicating which node numbers between 64 and 79 are occupied in the network
0005	Bit field indicating which node numbers between 80 and 95 are occupied in the network
0006	Bit field indicating which node numbers between 96 and 111 are occupied in the network
0007	Bit field indicating which node numbers between 112 and 127 are occupied in the network
0008	Bit field indicating which node numbers between 128 and 143 are occupied in the network

Example:  
Response to input register 0001:

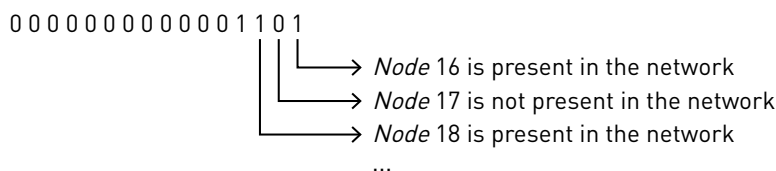

INPUT REGISTER	DATA
0000	Bit field indicating which node numbers between 1 and 15 are occupied in the network
0001	Bit field indicating which node numbers between 16 and 31 are occupied in the network
0002	Bit field indicating which node numbers between 16 and 31 are occupied in the network
0003	Bit field indicating which node numbers between 48 and 63 are occupied in the network
0004	Bit field indicating which node numbers between 64 and 79 are occupied in the network
0005	Bit field indicating which node numbers between 80 and 95 are occupied in the network
0006	Bit field indicating which node numbers between 96 and 111 are occupied in the network
0007	Bit field indicating which node numbers between 112 and 127 are occupied in the network
0008	Bit field indicating which node numbers between 128 and 143 are occupied in the network